



\\gos-fs14.global.amec.com\gos-fs-14-shared\GMM\DATA\PROJECT\38388 Enoch Hill Extension Wind Farm Surveys\040 Design\ACAD\852398-WSPE-FG-C-00005_P01.1.dwg Originator: NEIL.PATTON

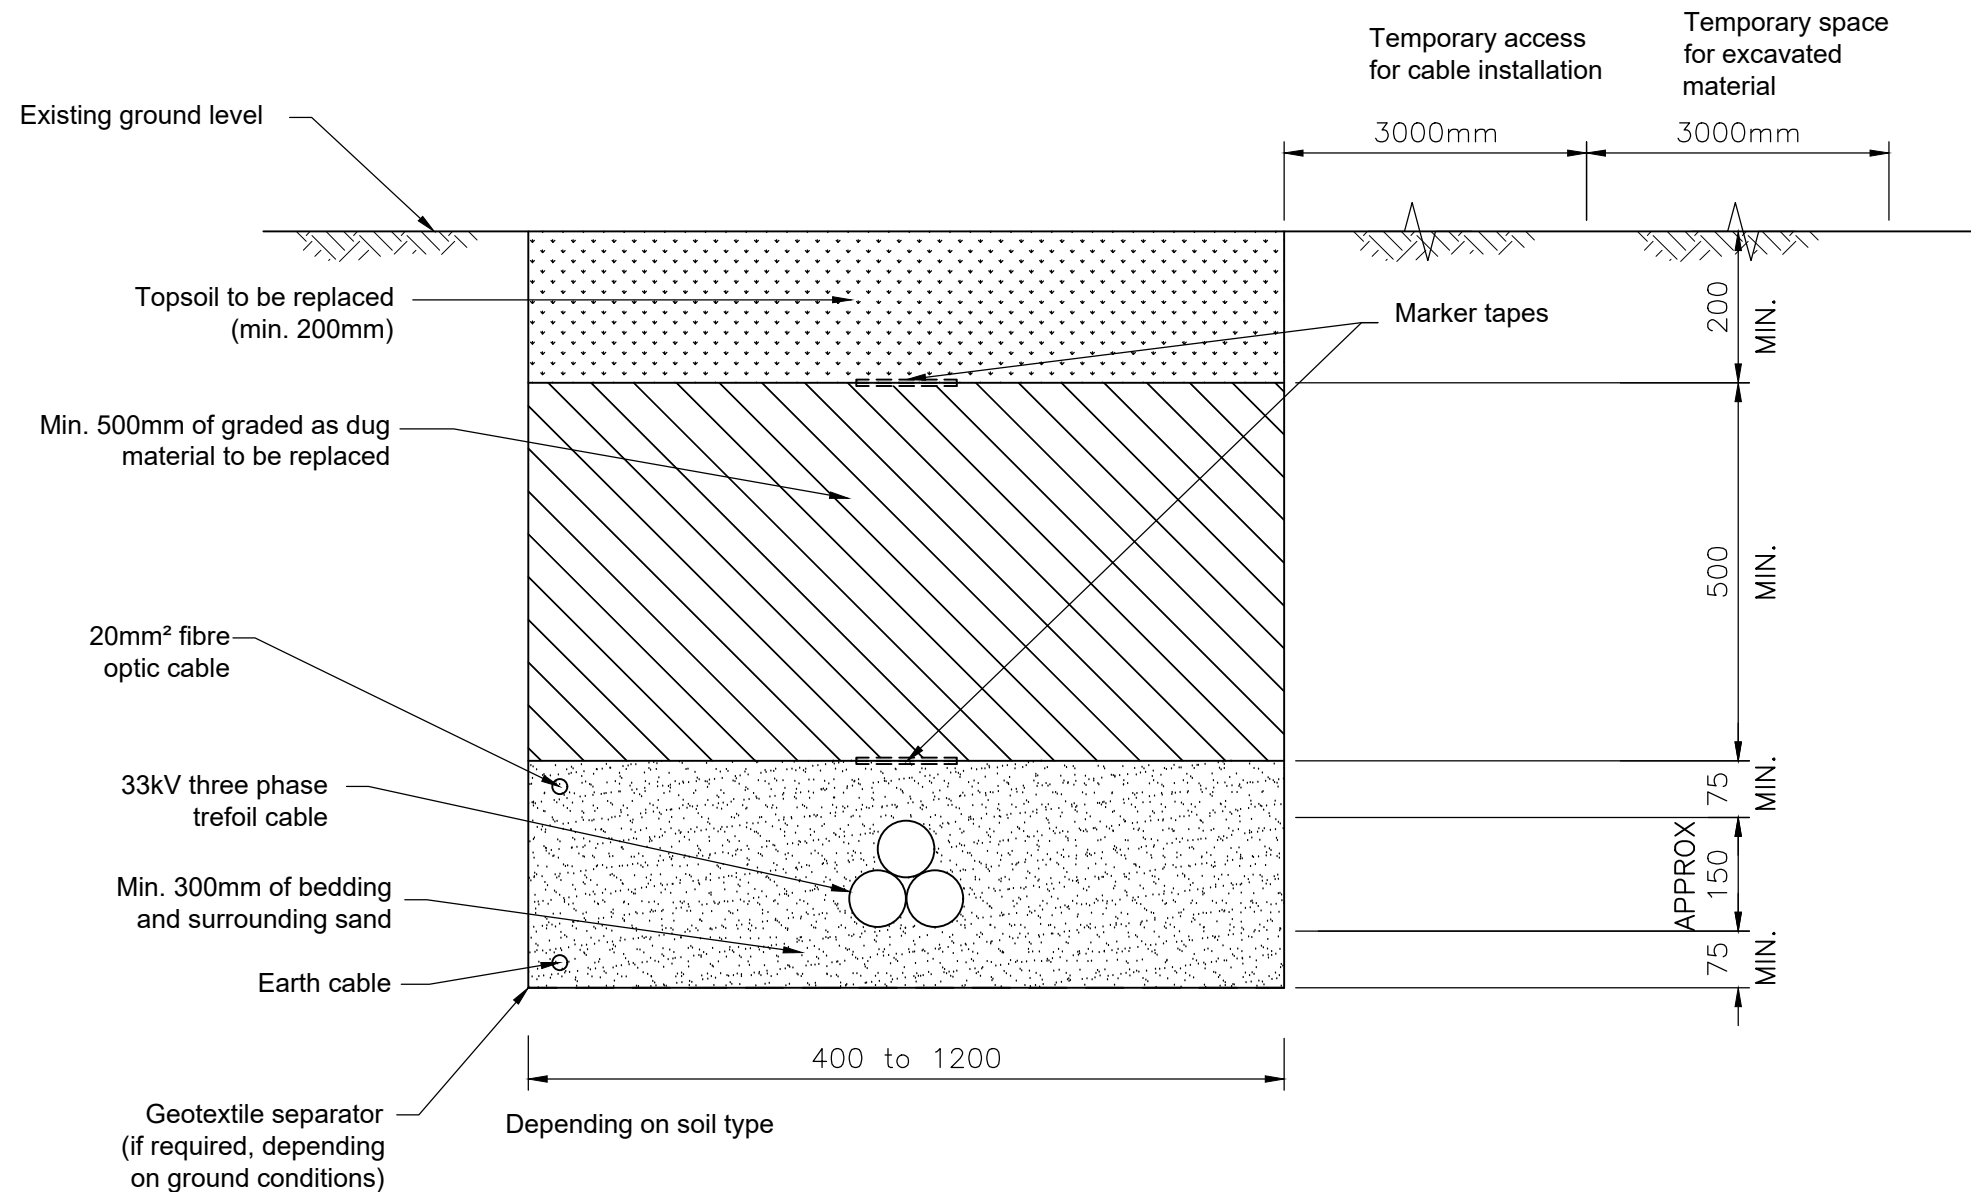

- Notes:
1. All dimensions are in millimetres unless noted otherwise.
 2. Cable routed to run adjacent to site roads.
 3. Above ground cable markers to be located as required.



Typical Cable Trench Detail
(typically adjacent to road)
1:10 @ A3

Client

RWE

Enoch Hill 2 Wind Farm
Environmental Impact Assessment Report

Figure 3.6
Typical cable trench cross section

March 2023

wsp